



Location: _____



GI-XL-250-HF HIGH FLOW, 250 GPM PLASTIC GREASE INTERCEPTOR

Specification: T&C GI-XL-250 - 250 GPM high flow grease interceptor with a limited lifetime warranty and is made in the USA out of seamless, rotationally molded High Density Polyethylene with 3/8" uniform wall thickness. Interceptor designed for above or below ground installation. Interceptor includes a dual adjustable lid system, internal flow control, sample port access, and multiple outlet options. Steel encased composite lid provides a water / gas tight seal and have a minimum of 20,000 lbs. load capacity. The lid is designed in accordance with the loading requirements of AASHTO H20.

Function: Used in restaurants, kitchens, institutions, industrial facilities such as food processing and packaging plants and other types of food processing areas where fat, oil and grease (FOG) drains with the wastewater. Narrow width permits access through doorways and down stairwells. High Density Polyethylene construction ensures a lightweight installation process (two people can move and install it).

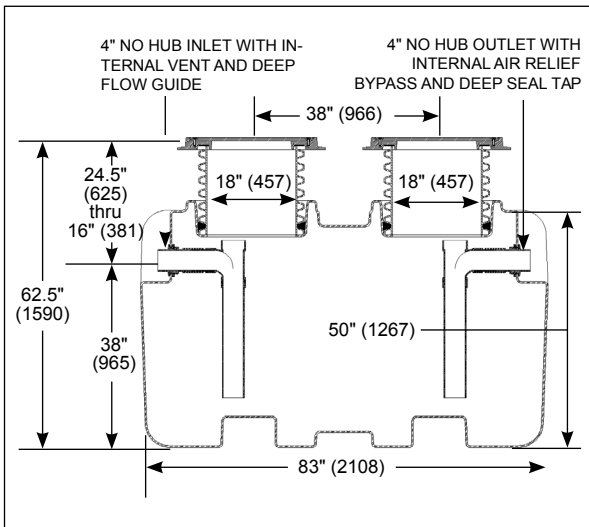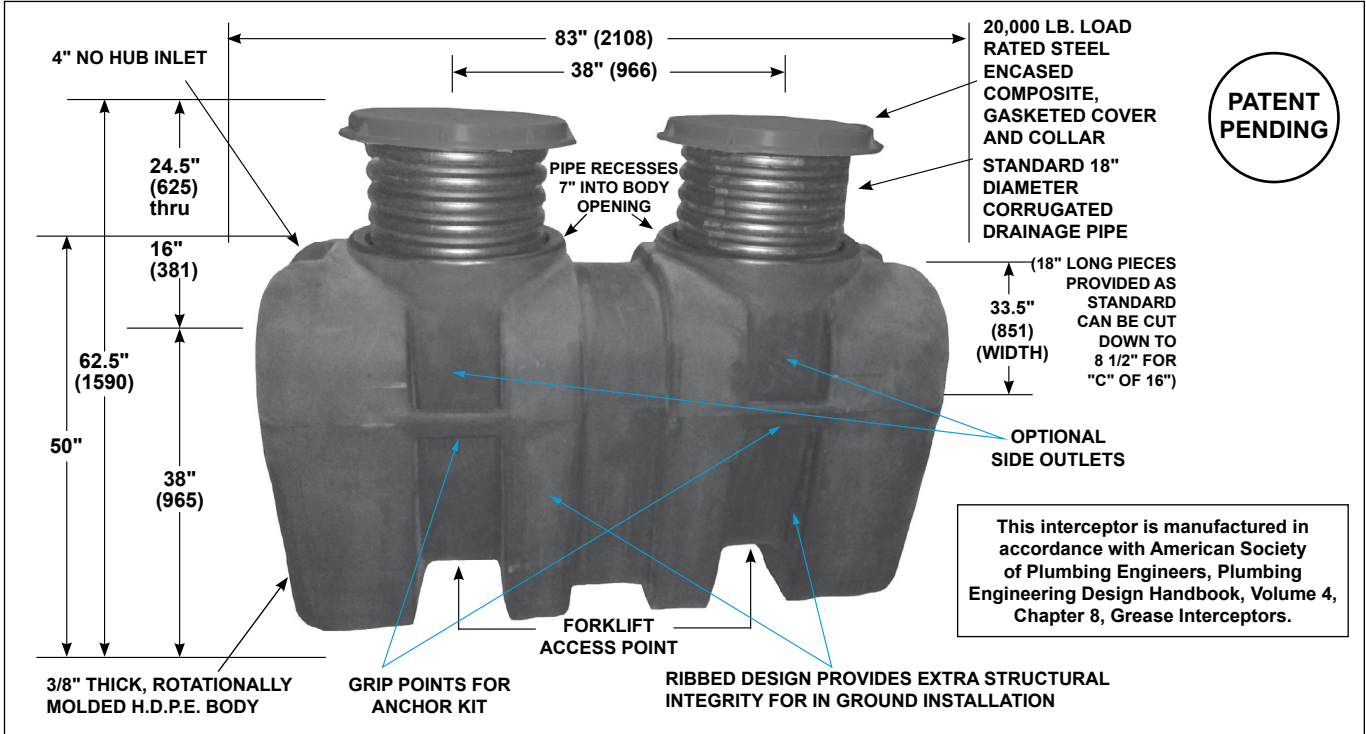

MODEL NO.	FLOW RATE (GPM)	LIQUID CAPACITY (GAL)	SHIPPING WEIGHT (Lbs.)
GI-XL-250-HF	250	300	275

- AK High water anchor kit (set of four)
- C Lid extension (specify "C" dimension required) (Max. of 72")
- CL Holddown brackets for lid (when installed above ground)
- DCL Direct Connect Lid (lid bolted to top of body)
- DI Ductile iron lid & collar
- DP Dosing pump
- EP Enzyme port
- FL-C Membrane clamp kit
- F6 6" No Hub Inlet / Outlet connection
- HLA High level alarm
- LHSI 4" no hub inlet on left hand side
- LHSO 4" no hub outlet on left hand side
- RHSI 4" no hub inlet on right hand side
- RHSO 4" no hub outlet on right hand side
- SB Sediment bucket
- SP External Sample Port (for existing construction. Inlet and Outlet on the same level)
- SP-OF External Sample Port (for new construction. Inlet higher than the outlet).
- T Female threaded connections



CALIFORNIA PROPOSITION 65 WARNING. This product contains chemicals known to the State of California to cause cancer and birth defects or other reproductive harm.

Job Name: _____ Page No: _____
 Section No: _____ Contractor: _____
 Schedule No: _____ Purchase Order No: _____