




### FEATURES

- Premium 18 gauge G90 Galvanized steel construction
- AMCA certified aluminum blade fans with TEFC motor standard
- UL listed color correct fluorescent light fixtures
- 20 x 20 Industry standard filters
- 100 F.P.M. standard booth velocity
- Welded tube steel product doors
- Easy nut & bolt assembly with 3D exploded view drawings

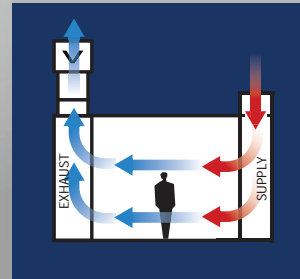

### CROSSDRAFT

- Horizontal Airflow
- Customizable Options
- Filtered Supply Air
- Drive Through Option
- Vapor Tight Lighting

### Premium Components

Optional heated Makeup Air Units (M.A.U.) can be added with high temperature bake cycle and energy saving recycle.

AMCA certified fans with EPACT compliant TEFC motors are standard. Fans have remote bearing lubrication, aluminum spark resistant blades, and heavy duty powder coated housings.

Booths are designed to meet or exceed NFPA33 and IFC Chapter 24 requirements. Consult your local authority having jurisdiction for additional requirements before purchasing.




Optional Compact PLC Based Control Center




Optional Filtered Product Doors

# ICD - INDUSTRIAL CROSSDRAFT BOOTH


MODEL	Working Dim. (WD)			Overall Dim. (OD)			Light Fixtures	Intake Filters	Exhaust Filters	Exhaust Fan Sized at 100FPM @ 1/2" S.P.
	W	H	D	W	H	D				
<b>14'-0" Wide</b>										
ICD-14-10-24	14'-0"	10'-0"	23'-10"	15'-4"	10'-8"	24'-2"	9	24	24	36" 5hp- 14,000cfm
ICD-14-10-26	14'-0"	10'-0"	25'-11"	15'-4"	10'-8"	26'-3"	10	24	24	36" 5hp- 14,000cfm
ICD-14-10-28	14'-0"	10'-0"	27'-11"	15'-4"	10'-8"	28'-3"	10	24	24	36" 5hp- 14,000cfm
ICD-14-10-30	14'-0"	10'-0"	29'-11"	15'-4"	10'-8"	30'-3"	11	24	24	36" 5hp- 14,000cfm
ICD-14-10-32	14'-0"	10'-0"	31'-11"	15'-4"	10'-8"	32'-3"	12	24	24	36" 5hp- 14,000cfm
BWP-14-10	-	-	-	14'-4"	10'-2"	3'-8 1/2"	-	-	32	36" 5hp- 14,000cfm
PD-10-10	9'-0"	9'-6"	-	10'-0"	10'-0"	-	-	-	-	-
ICD-14-12-24	14'-0"	12'-0"	23'-10"	15'-4"	12'-8"	24'-2"	11	34	34	42" 5hp- 16800cfm
ICD-14-12-26	14'-0"	12'-0"	25'-11"	15'-4"	12'-8"	26'-3"	12	34	34	42" 5hp- 16800cfm
ICD-14-12-28	14'-0"	12'-0"	27'-11"	15'-4"	12'-8"	28'-3"	12	34	34	42" 5hp- 16800cfm
ICD-14-12-30	14'-0"	12'-0"	29'-11"	15'-4"	12'-8"	30'-3"	13	34	34	42" 5hp- 16800cfm
ICD-14-12-32	14'-0"	12'-0"	31'-11"	15'-4"	12'-8"	32'-3"	13	34	34	42" 5hp- 16800cfm
BWP-14-12	-	-	-	14'-4"	12'-2"	4'-2 1/2"	-	-	40	42" 5hp- 16800cfm
PD-10-12	9'-0"	9'-6"	-	10'-0"	12'-0"	-	-	-	-	-
<b>16'-0" Wide</b>										
ICD-16-16-32	16'-0"	16'-0"	31'-11"	17'-4"	16'-8"	32'-3"	21	48	48	42" 7.5hp- 25,600cfm
ICD-16-16-40	16'-0"	16'-0"	40'-0"	17'-4"	16'-8"	40'-4"	26	48	48	42" 7.5hp- 25,600cfm
ICD-16-16-48	16'-0"	16'-0"	48'-1"	17'-4"	16'-8"	48'-5"	31	48	48	42" 7.5hp- 25,600cfm
ICD-16-16-56	16'-0"	16'-0"	56'-2"	17'-4"	16'-8"	56'-6"	36	48	48	42" 7.5hp- 25,600cfm
ICD-16-16-60	16'-0"	16'-0"	60'-3"	17'-4"	16'-8"	60'-7"	38	48	48	42" 7.5hp- 25,600cfm
BWP-16-16	-	-	-	16'-4"	16'-2"	4'-2 1/2"	-	-	72	42" 7.5hp- 25,600cfm
PD-12-12	11'-0"	11'-6"	-	12'-0"	12'-0"	-	-	-	-	-
<b>18'-0" Wide</b>										
ICD-18-16-32	18'-0"	16'-0"	31'-11"	19'-8"	16'-10"	32'-3"	24	64	64	48" 7.5hp- 28,800cfm
ICD-18-16-40	18'-0"	16'-0"	40'-0"	19'-8"	16'-10"	40'-4"	29	64	64	48" 7.5hp- 28,800cfm
ICD-18-16-48	18'-0"	16'-0"	48'-1"	19'-8"	16'-10"	48'-5"	35	64	64	48" 7.5hp- 28,800cfm
ICD-18-16-56	18'-0"	16'-0"	56'-2"	19'-8"	16'-10"	56'-6"	41	64	64	48" 7.5hp- 28,800cfm
ICD-18-16-60	18'-0"	16'-0"	60'-3"	19'-8"	16'-10"	60'-7"	44	64	64	48" 7.5hp- 28,800cfm
BWP-18-16	-	-	-	18'-4"	16'-2"	4'-8 1/2"	-	-	80	48" 7.5hp- 28,800cfm
PD-14-12	13'-0"	11'-6"	-	14'-0"	12'-0"	-	-	-	-	-
<b>20'-0" Wide</b>										
ICD-20-16-32	20'-0"	16'-0"	31'-11"	21'-8"	16'-10"	32'-3"	26	64	64	48" 10hp- 32,000cfm
ICD-20-16-40	20'-0"	16'-0"	40'-0"	21'-8"	16'-10"	40'-4"	32	64	64	48" 10hp- 32,000cfm
ICD-20-16-48	20'-0"	16'-0"	48'-1"	21'-8"	16'-10"	48'-5"	39	64	64	48" 10hp- 32,000cfm
ICD-20-16-56	20'-0"	16'-0"	56'-2"	21'-8"	16'-10"	56'-6"	45	64	64	48" 10hp- 32,000cfm
ICD-20-16-60	20'-0"	16'-0"	60'-3"	21'-8"	16'-10"	60'-7"	48	64	64	48" 10hp- 32,000cfm
BWP-20-16	-	-	-	20'-4"	16'-2"	4'-8 1/2"	-	-	88	48" 10hp- 32,000cfm
PD-16-12	15'-0"	11'-6"	-	16'-0"	12'-0"	-	-	-	-	-

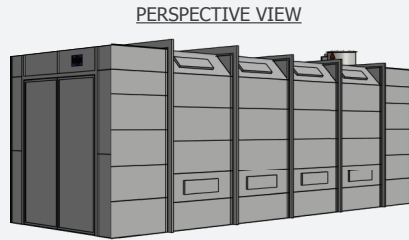

PERSPECTIVE VIEW



FRONT VIEW

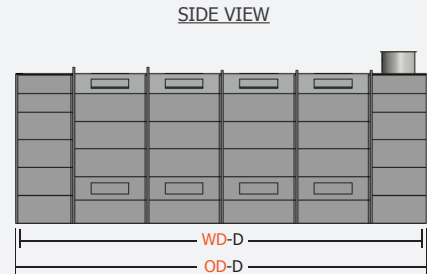

SIDE VIEW

**NOTE:** Model shown includes pant leg plenum with bridge (exhaust) and pant leg plenum with bridge (intake).

## TABLE LEGEND

ICD = Industrial Crossdraft Booth: comes standard with pant leg bridge plenum for exhaust and intake

BWP = Back Wall Plenum: optional external exhaust plenum (adds depth to the overall dimension)

PD = Product Doors. Options: Standard, Filtered, Bi-fold, or Tri-fold. Filtered Product Doors can be used in place of an intake plenum

Standard Motors: 1hp and greater are 230/460V three phase, fractional hp motors are 115/230V single phase. Additional motor configurations available.



www.rohner-usa.com  
888.885.7641


# MCD - MODIFIED CROSSDRAFT BOOTH

## Working Dim. (WD)


## Overall Dim. (OD)

MODEL	W	H	D	W	H	D	Light Fixtures	Intake Filters	Exhaust Filters	Exhaust Fan Sized at 100FPM @ 1/2" S.P.
<b>14'-0" Wide</b>										
MCD-14-10-24	14'-0"	10'-0"	23'-10"	15'-4"	12'-8"	24'-2"	9	20	24	36" 5hp- 14,000cfm
MCD-14-10-26	14'-0"	10'-0"	25'-11"	15'-4"	12'-8"	26'-3"	10	20	24	36" 5hp- 14,000cfm
MCD-14-10-28	14'-0"	10'-0"	27'-11"	15'-4"	12'-8"	28'-3"	10	20	24	36" 5hp- 14,000cfm
MCD-14-10-30	14'-0"	10'-0"	29'-11"	15'-4"	12'-8"	30'-3"	11	20	24	36" 5hp- 14,000cfm
MCD-14-10-32	14'-0"	10'-0"	31'-11"	15'-4"	12'-8"	32'-3"	12	20	24	36" 5hp- 14,000cfm
BWP-14-10	-	-	-	14'-4"	10'-2"	3'-8 1/2"	-	-	32	36" 5hp- 14,000cfm
PD-10-10	9'-0"	9'-6"	-	10'-0"	10'-0"	-	-	-	-	-
MCD-14-12-24	14'-0"	12'-0"	23'-10"	15'-4"	14'-8"	24'-2"	11	25	34	42" 5hp- 16800cfm
MCD-14-12-26	14'-0"	12'-0"	25'-11"	15'-4"	14'-8"	26'-3"	12	25	34	42" 5hp- 16800cfm
MCD-14-12-28	14'-0"	12'-0"	27'-11"	15'-4"	14'-8"	28'-3"	12	25	34	42" 5hp- 16800cfm
MCD-14-12-30	14'-0"	12'-0"	29'-11"	15'-4"	14'-8"	30'-3"	13	25	34	42" 5hp- 16800cfm
MCD-14-12-32	14'-0"	12'-0"	31'-11"	15'-4"	14'-8"	32'-3"	13	25	34	42" 5hp- 16800cfm
BWP-14-12	-	-	-	14'-4"	12'-2"	4'-2 1/2"	-	-	40	42" 5hp- 16800cfm
PD-10-12	9'-0"	11'-6"	-	10'-0"	12'-0"	-	-	-	-	-
<b>16'-0" Wide</b>										
MCD-16-16-32	16'-0"	16'-0"	31'-11"	17'-4"	18'-8"	32'-3"	21	48	48	42" 7.5hp- 25,600cfm
MCD-16-16-40	16'-0"	16'-0"	40'-0"	17'-4"	18'-8"	40'-4"	26	48	48	42" 7.5hp- 25,600cfm
MCD-16-16-48	16'-0"	16'-0"	48'-1"	17'-4"	18'-8"	48'-5"	31	48	48	42" 7.5hp- 25,600cfm
MCD-16-16-56	16'-0"	16'-0"	56'-2"	17'-4"	18'-8"	56'-6"	36	48	48	42" 7.5hp- 25,600cfm
MCD-16-16-60	16'-0"	16'-0"	60'-3"	17'-4"	18'-8"	60'-7"	38	48	48	42" 7.5hp- 25,600cfm
BWP-16-16	-	-	-	16'-4"	16'-2"	4'-2 1/2"	-	-	72	42" 7.5hp- 25,600cfm
PD-12-12	11'-0"	11'-6"	-	12'-0"	12'-0"	-	-	-	-	-
<b>18'-0" Wide</b>										
MCD-18-16-32	18'-0"	16'-0"	31'-11"	19'-8"	18'-10"	32'-3"	24	56	64	48" 7.5hp- 28,800cfm
MCD-18-16-40	18'-0"	16'-0"	40'-0"	19'-8"	18'-10"	40'-4"	29	56	64	48" 7.5hp- 28,800cfm
MCD-18-16-48	18'-0"	16'-0"	48'-1"	19'-8"	18'-10"	48'-5"	35	56	64	48" 7.5hp- 28,800cfm
MCD-18-16-56	18'-0"	16'-0"	56'-2"	19'-8"	18'-10"	56'-6"	41	56	64	48" 7.5hp- 28,800cfm
MCD-18-16-60	18'-0"	16'-0"	60'-3"	19'-8"	18'-10"	60'-7"	44	56	64	48" 7.5hp- 28,800cfm
BWP-18-16	-	-	-	18'-4"	16'-2"	4'-8 1/2"	-	-	80	48" 7.5hp- 28,800cfm
PD-14-12	13'-0"	11'-6"	-	14'-0"	12'-0"	-	-	-	-	-
<b>20'-0" Wide</b>										
MCD-20-16-32	20'-0"	16'-0"	31'-11"	21'-8"	18'-10"	32'-3"	26	64	64	48" 10hp- 32,000cfm
MCD-20-16-40	20'-0"	16'-0"	40'-0"	21'-8"	18'-10"	40'-4"	32	64	64	48" 10hp- 32,000cfm
MCD-20-16-48	20'-0"	16'-0"	48'-1"	21'-8"	18'-10"	48'-5"	39	64	64	48" 10hp- 32,000cfm
MCD-20-16-56	20'-0"	16'-0"	56'-2"	21'-8"	18'-10"	56'-6"	45	64	64	48" 10hp- 32,000cfm
MCD-20-16-60	20'-0"	16'-0"	60'-3"	21'-8"	18'-10"	60'-7"	48	64	64	48" 10hp- 32,000cfm
BWP-20-16	-	-	-	20'-4"	16'-2"	4'-8 1/2"	-	-	88	48" 10hp- 32,000cfm
PD-16-12	15'-0"	11'-6"	-	16'-0"	12'-0"	-	-	-	-	-


PERSPECTIVE VIEW

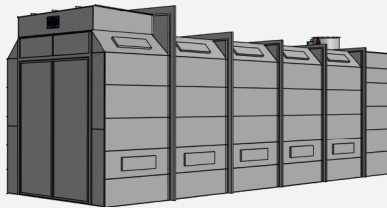

FRONT VIEW



SIDE VIEW

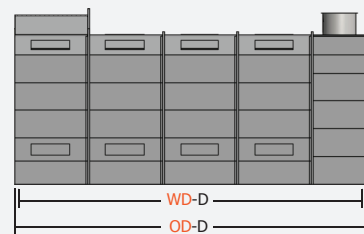

**NOTE:** Model shown includes pant leg plenum with bridge (exhaust) and front ceiling plenum (intake).

## TABLE LEGEND

MCD = Modified Crossdraft Booth

BWP = Back Wall Plenum, optional external exhaust plenum (adds depth to overall dimension)

PD = Product Doors. Options: Standard, Filtered, Bi-fold, or Tri-fold. Filtered Product Doors can be used in place of an intake plenum

Standard Motors: 1hp and greater are 230/460V three phase, fractional hp motors are 115/230V single phase. Additional motor configurations available.



www.rohner-usa.com  
888.885.7641

# CROSSDRAFT SPECIFICATIONS

BOOTH DESIGN	STD.	OPT.	BOOTH DESIGN	STD.	OPT.
18 Gauge galvanized construction	✓		NESHAP compliant multistage filter system		✓
20" x 20" exhaust filter frames with wire grids	✓		3' x 7' Personnel access door with 18" x 24" tempered glass window		✓
Class 1 Div. II sealed inside access light fixtures with color correct lamps	✓		Blanket media track		✓
Spark resistant tube axial fan w/ TEFC motor	✓		Filtered product door		✓
High static exhaust fan		✓	Dual entry (drive through) product doors		✓
Powder coated white finish		✓	Heated makeup air unit (M.A.U.)		✓

## CROSSDRAFT/MODIFIED DIAGRAM

Model Number = (Ex: ICD-BWP-14-12-24-PPB)

ICD = Class & Booth Type


BWP = Exhaust Type

14 = Working Width

12 = Working Height

24 = Working Depth

PPB = Intake Type

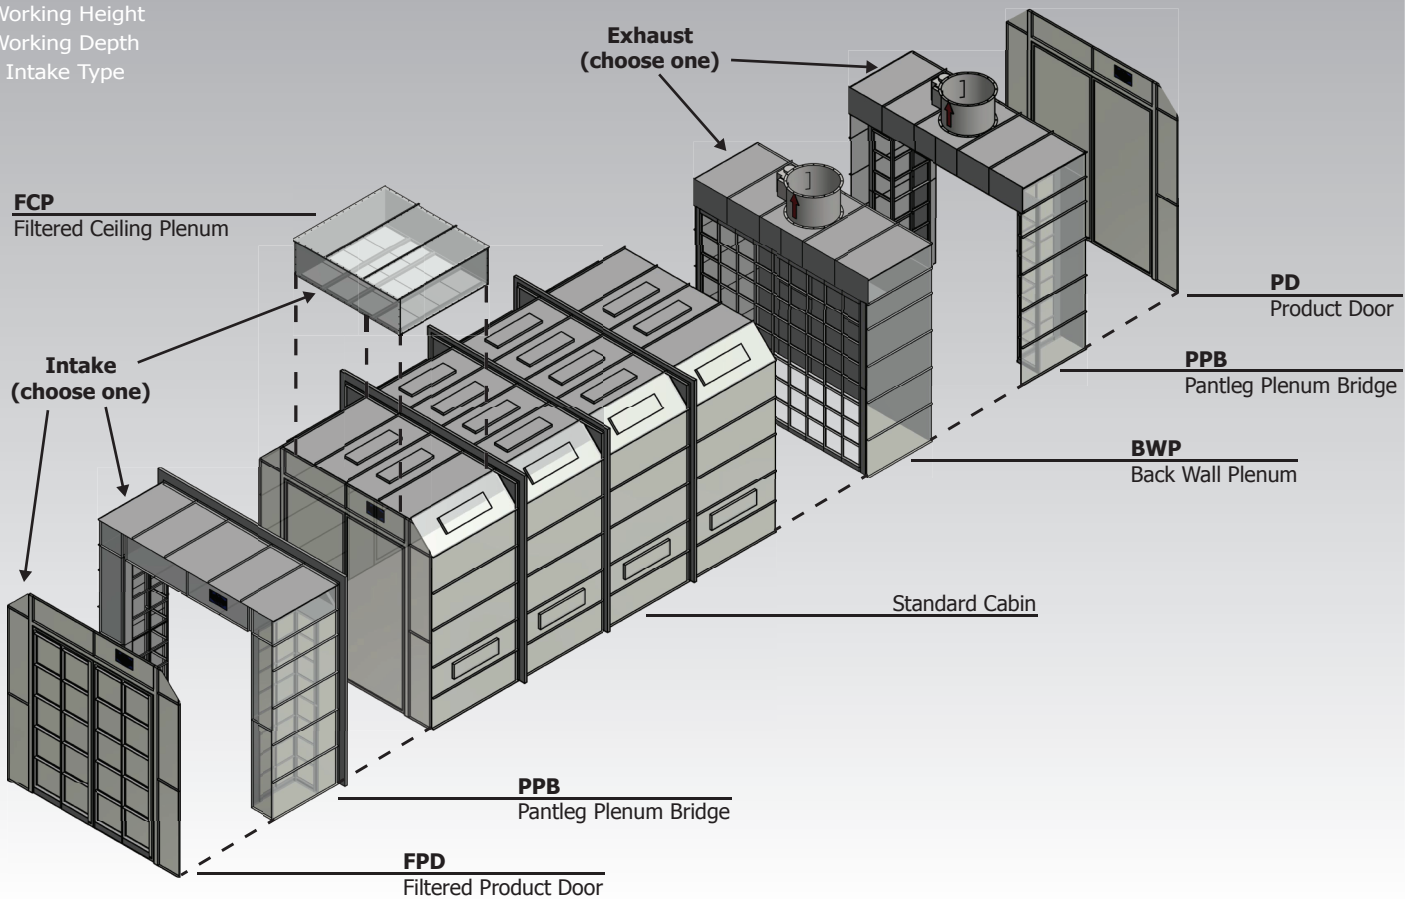

**NOTE:** Personnel doors are available on cabin sections. Product doors are available in Double Swing, Filtered, Bi-fold, Tri-fold, or Roll-up models.

Booth exhaust plenums and filters are designed for particulate removal only! Volatile organic compounds (V.O.C.) removal requires optional equipment.

Specifications and designs are subject to change, and substitutions without notice are at the manufacturer's sole discretion. Customer is responsible for determining the suitability of the equipment for its intended use. Additional equipment or modifications may be required to meet local building and process-specific regulatory codes and are the responsibility of the Customer.

**Rohner**

[www.rohner-usa.com](http://www.rohner-usa.com)  
888.885.7641